



NOTE:
PAINT ALL METAL ROOF CAPS, INTAKE HOODS
AND EXHAUST HOODS. SEE SPECIFICATIONS
(VERIFY AMOUNT WITH HVAC CONTRACTOR)


NOTE:
BRICK EXPANSION JOINTS SHALL NOT
EXCEED 40'-0" MAXIMUM SPACING

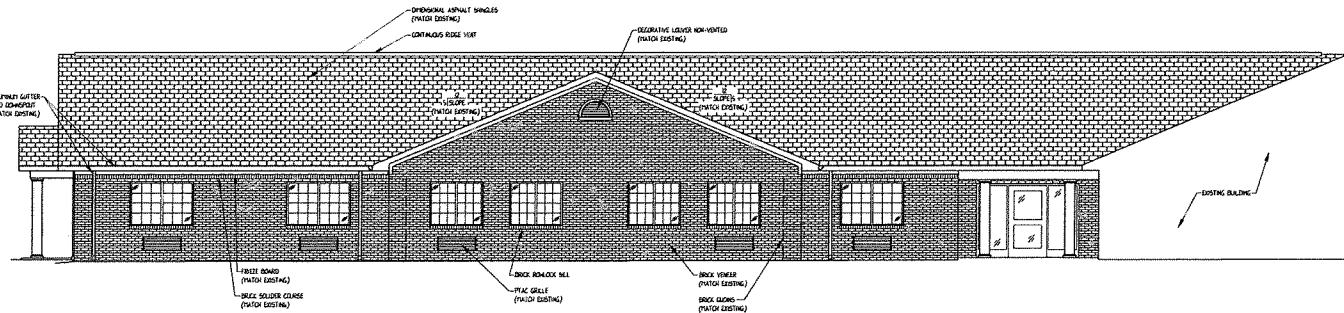


1 SOUTH EXTERIOR ELEVATION
3/16"=1'-0"

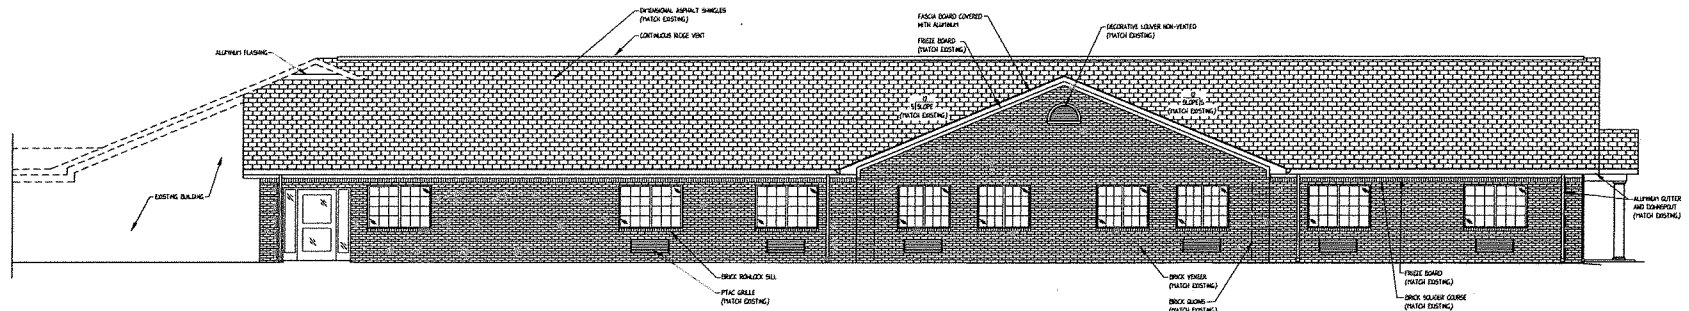


2 NORTH EXTERIOR ELEVATION
3/16"=1'-0"




WATER DEFLECTOR DETAIL
NOT TO SCALE

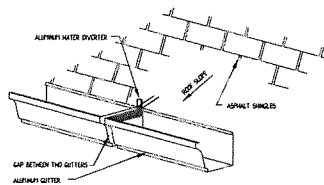


TYPICAL GUTTER EXPANSION JOINT
NOT TO SCALE



TYPICAL GUTTER DETAIL
3/16"=1'-0"

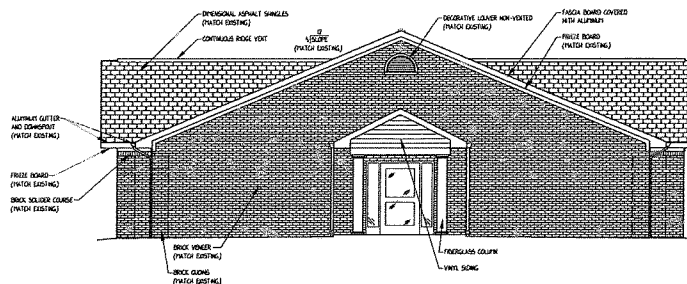

3 WEST EXTERIOR ELEVATION
3/16"=1'-0"

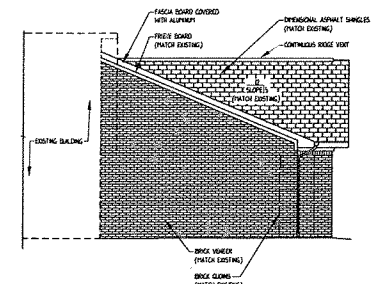

4 EAST EXTERIOR ELEVATION
3/16"=1'-0"



Ralph L. Pund
DATE: 4-3-17